



			Date	18/05/2023	Revitalizace multimodálního uzlu ve Dvoře Králové nad Labem	Kenergen s.r.o	Vzdálené ovládání				=		
			Ed								+		
			Appr										
Modification	Date	Name	Original		Replacement of	Replaced by						Page	5 / 9

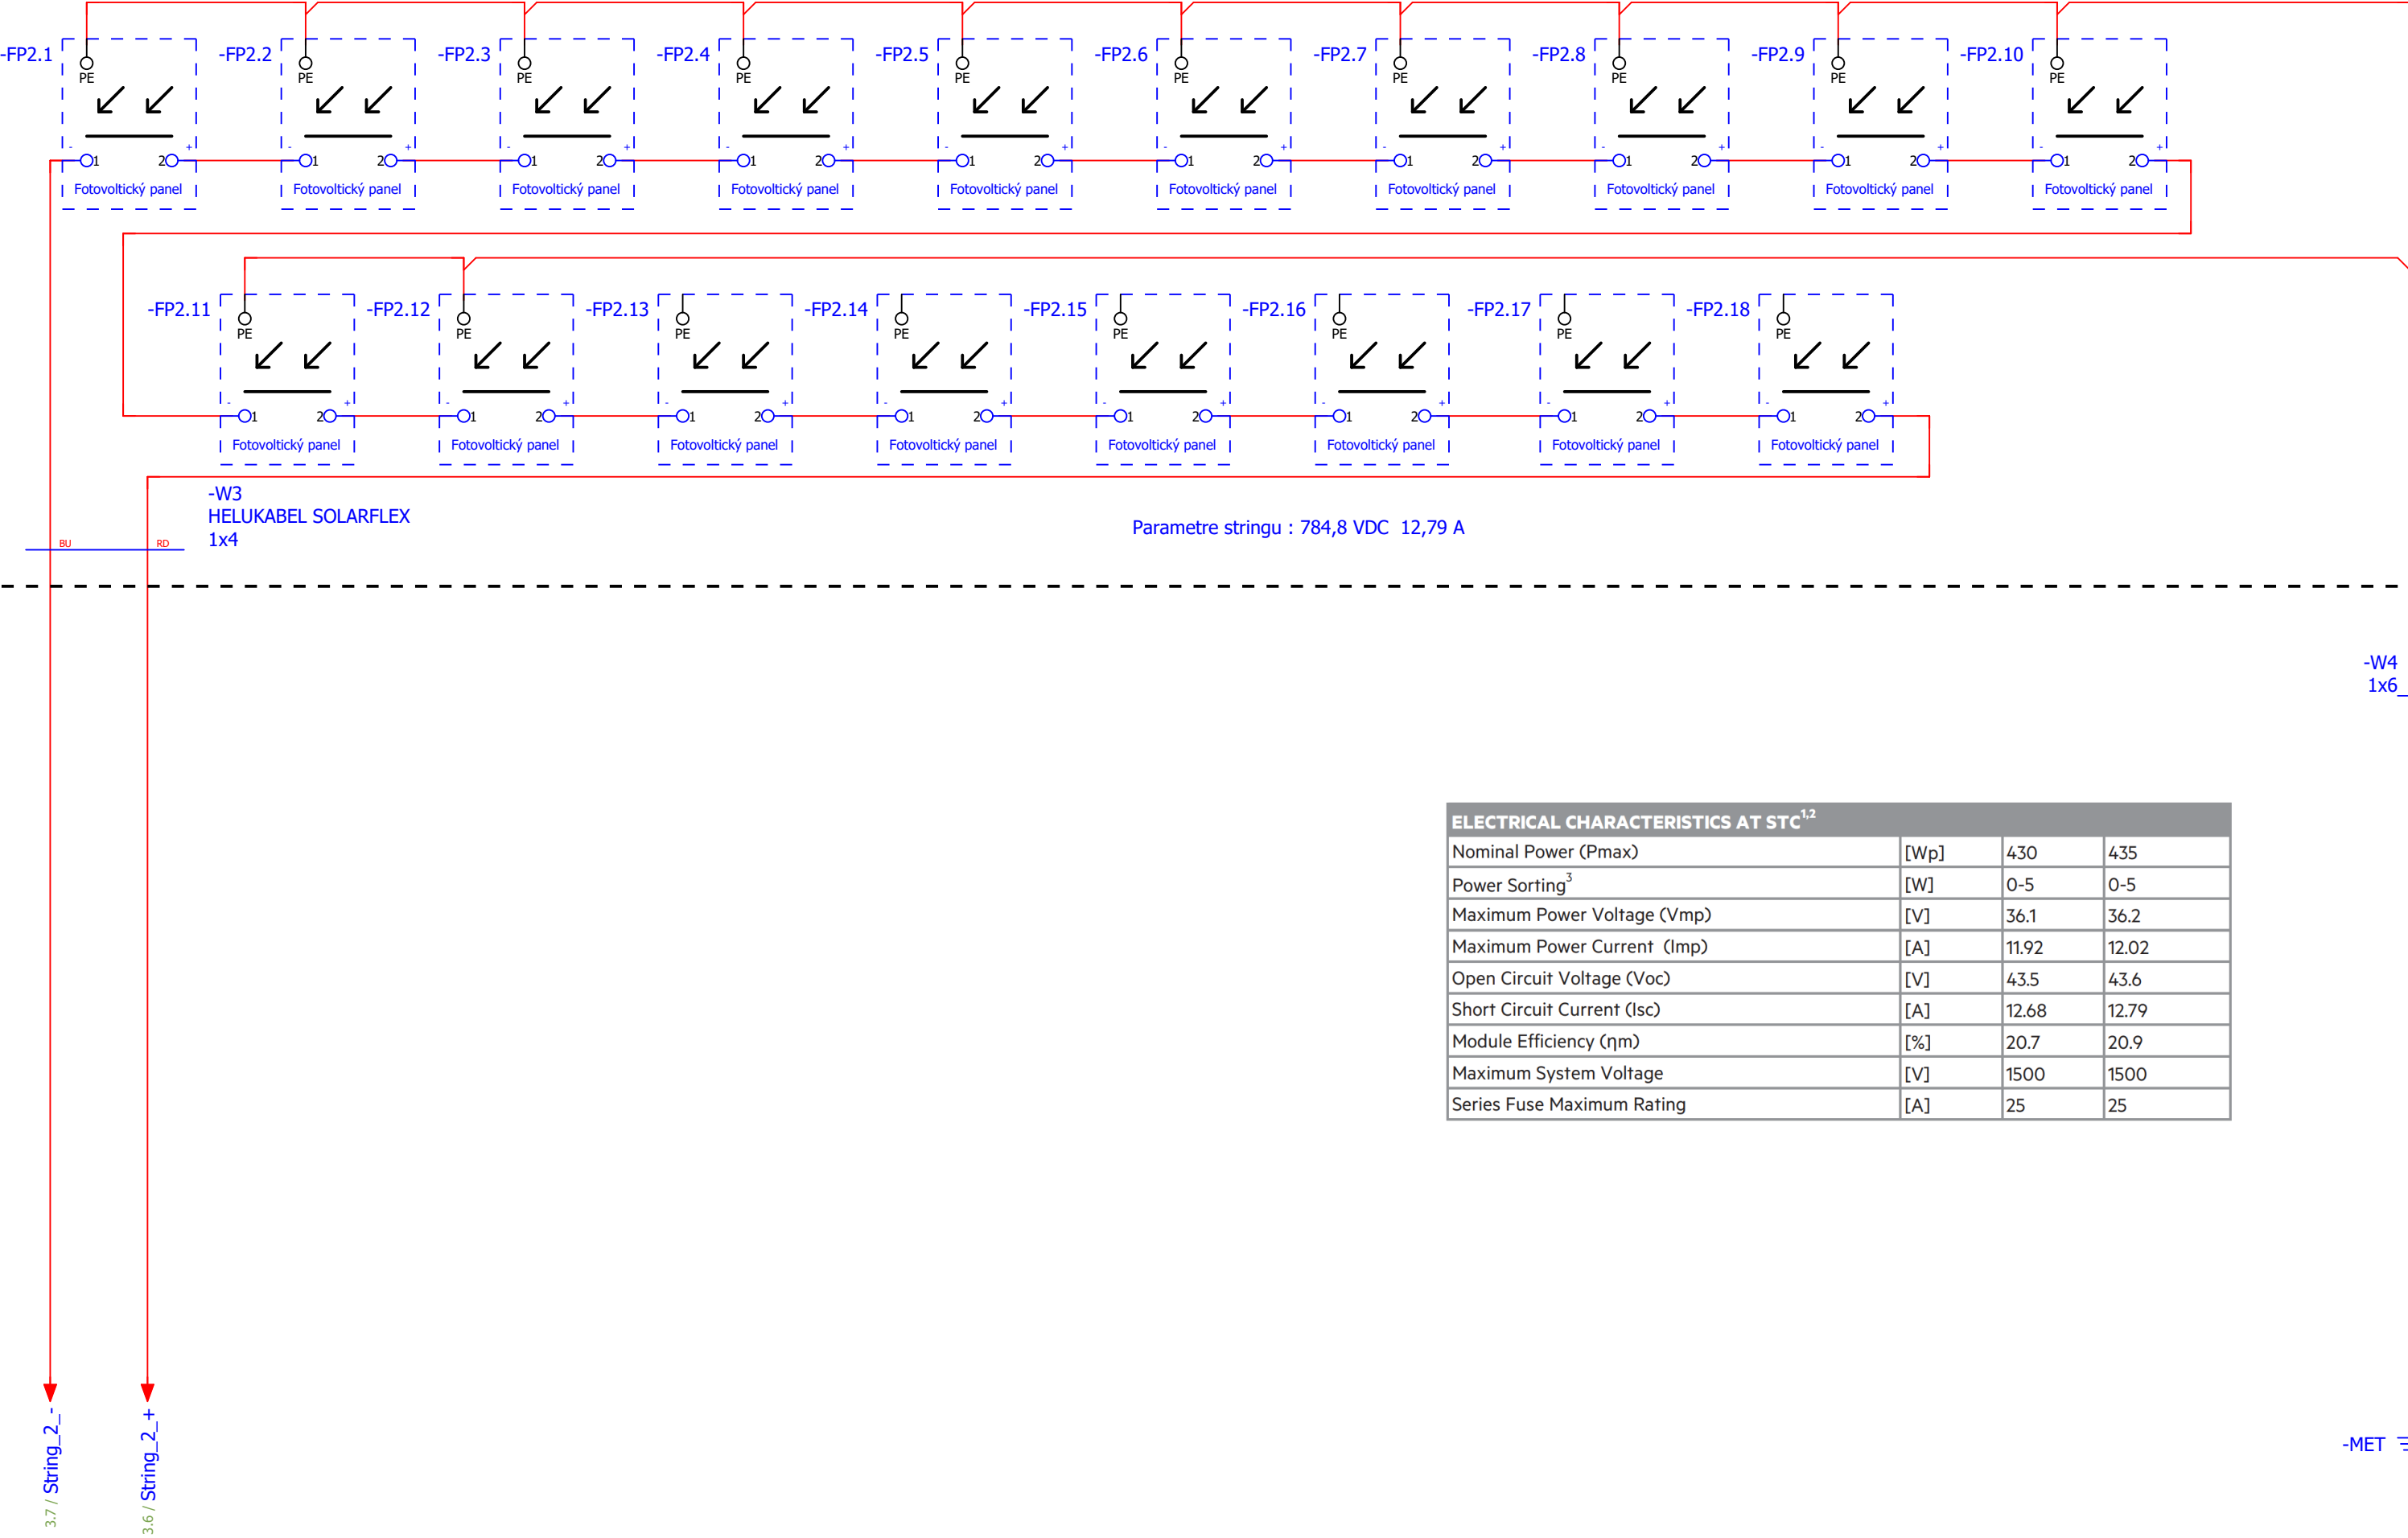

ELECTRICAL CHARACTERISTICS AT STC ^{1,2}			
Nominal Power (Pmax)	[Wp]	430	435
Power Sorting ³	[W]	0-5	0-5
Maximum Power Voltage (Vmp)	[V]	36.1	36.2
Maximum Power Current (Imp)	[A]	11.92	12.02
Open Circuit Voltage (Voc)	[V]	43.5	43.6
Short Circuit Current (Isc)	[A]	12.68	12.79
Module Efficiency (ηm)	[%]	20.7	20.9
Maximum System Voltage	[V]	1500	1500
Series Fuse Maximum Rating	[A]	25	25

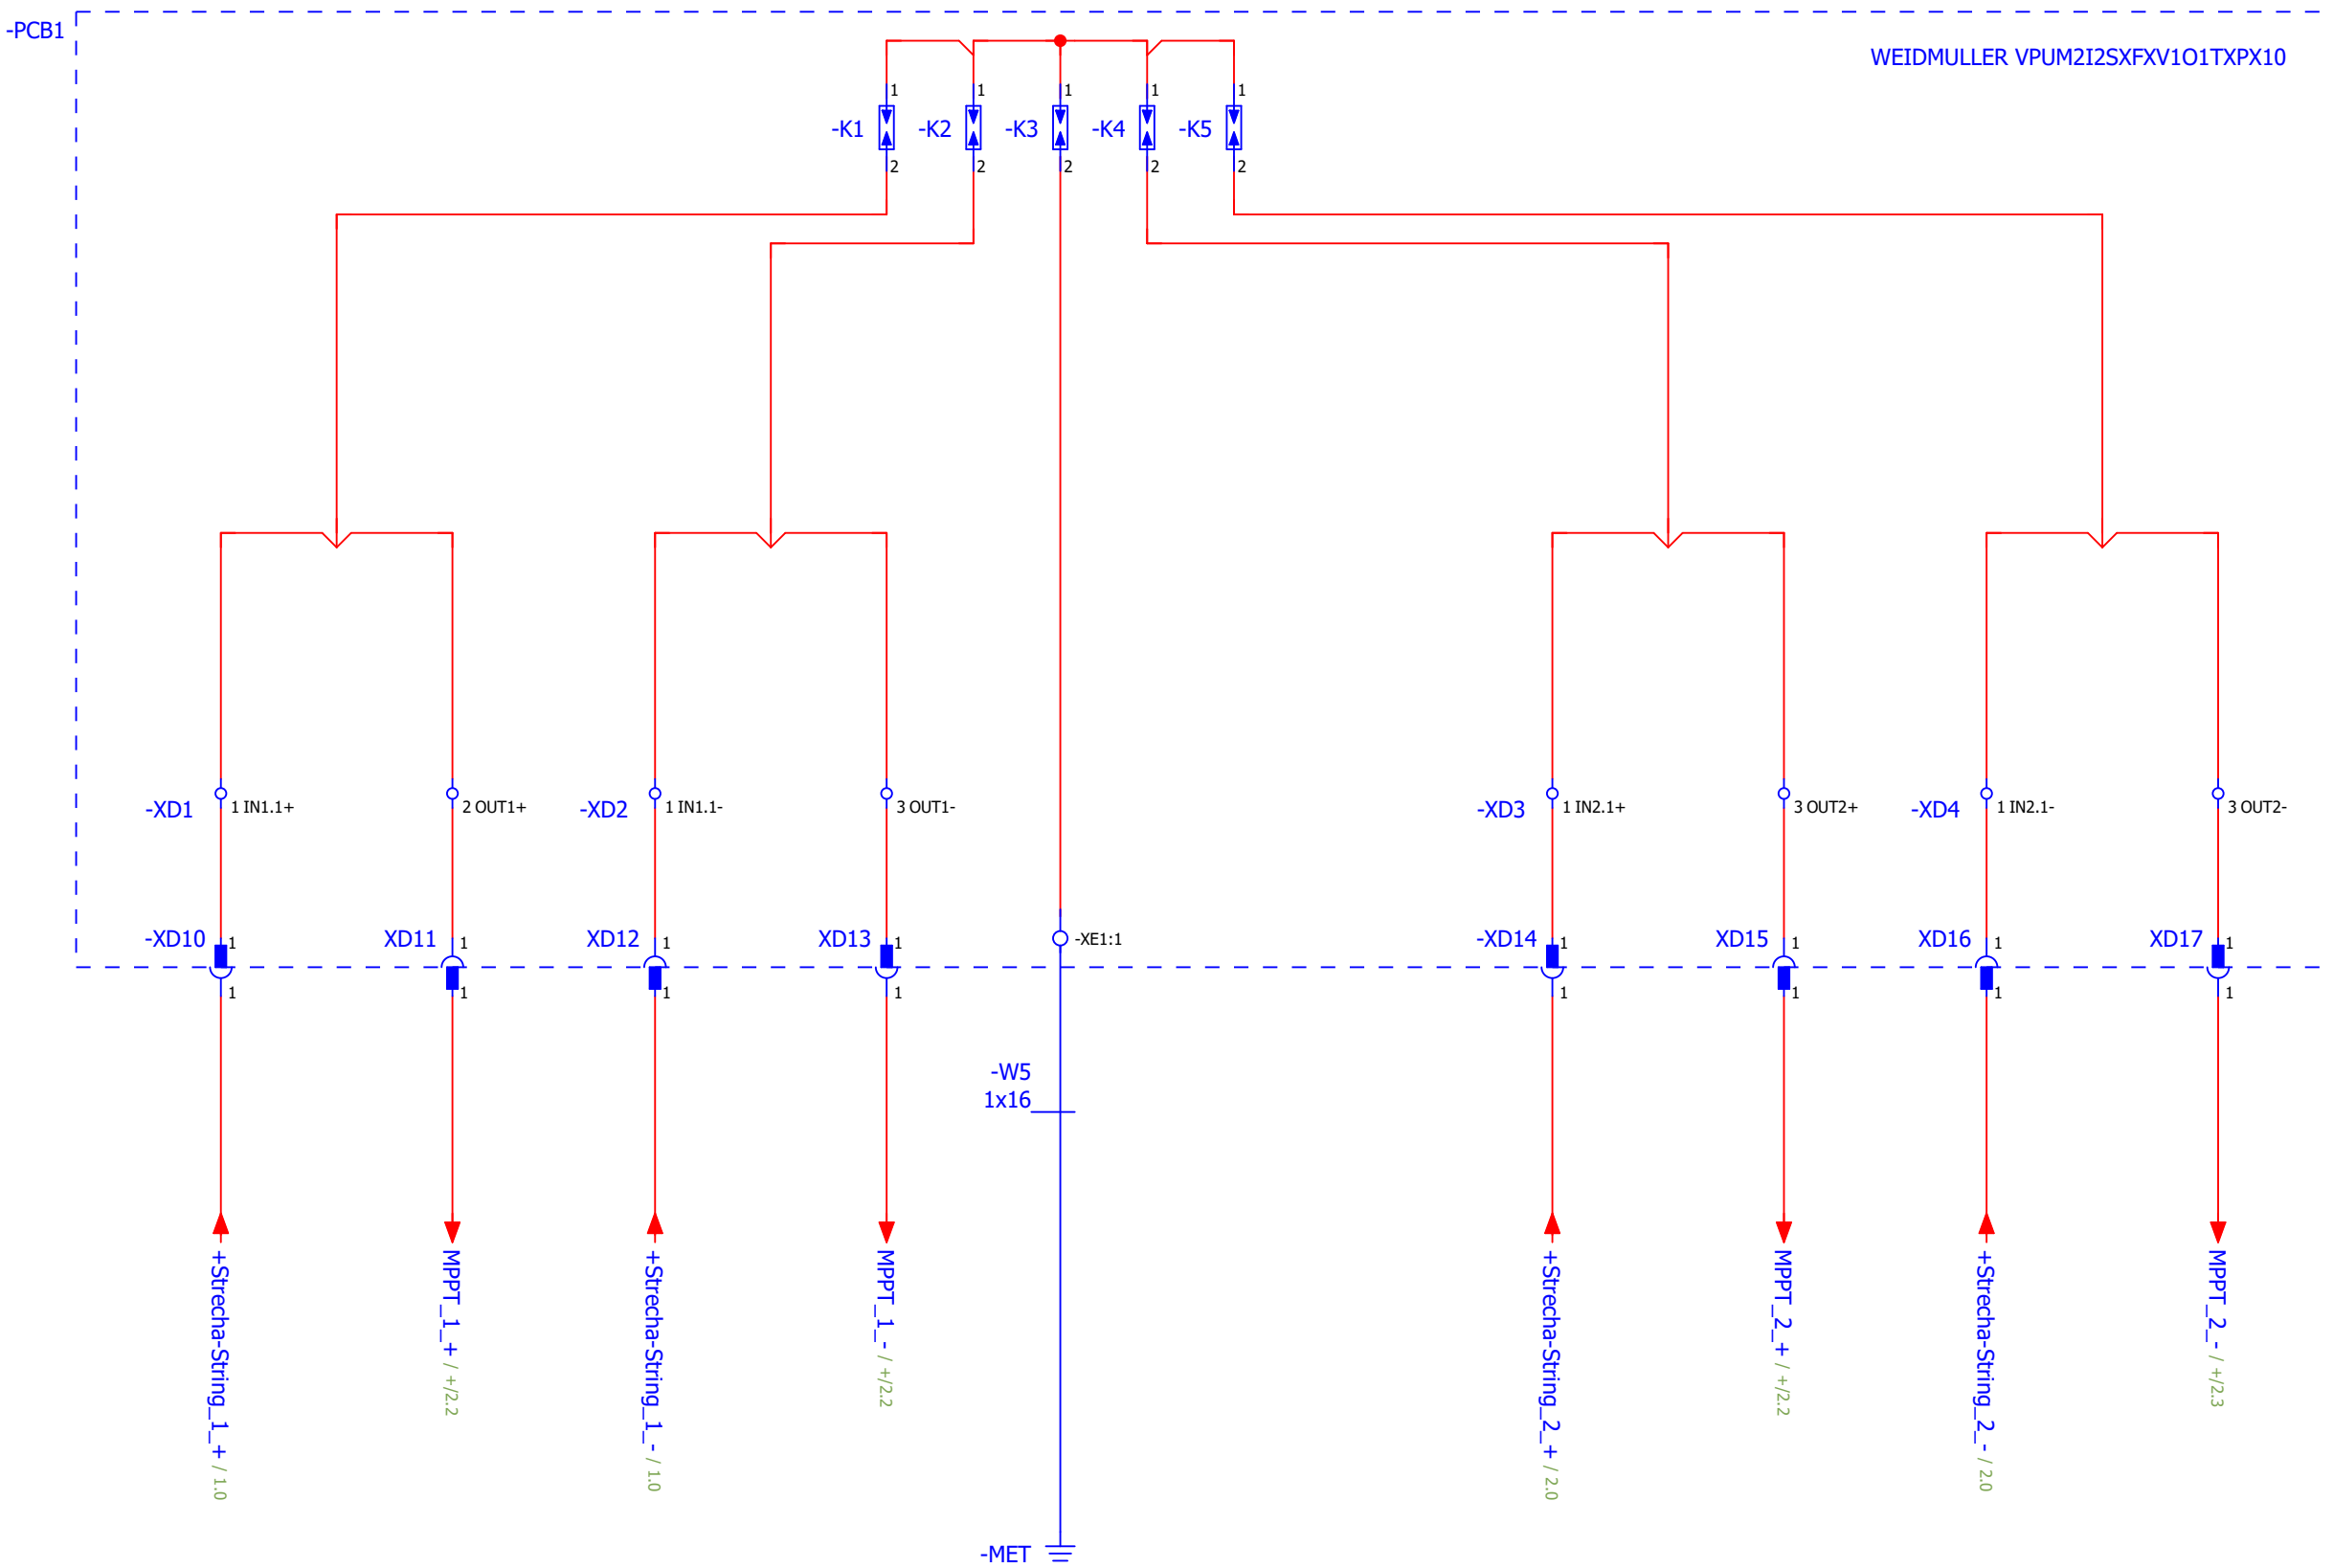

			Date	18/05/2023	Revitalizace multimodálního uzlu ve Dvoře Králové nad Labem		Kenergen s.r.o	Prepät'ovka	=	
			Ed						+ Strecha	
			Appr							Page 3
Modification	Date	Name	Original		Replacement of	Replaced by				Page 8 / 9

